

GOVERNMENT OF KARNATAKA

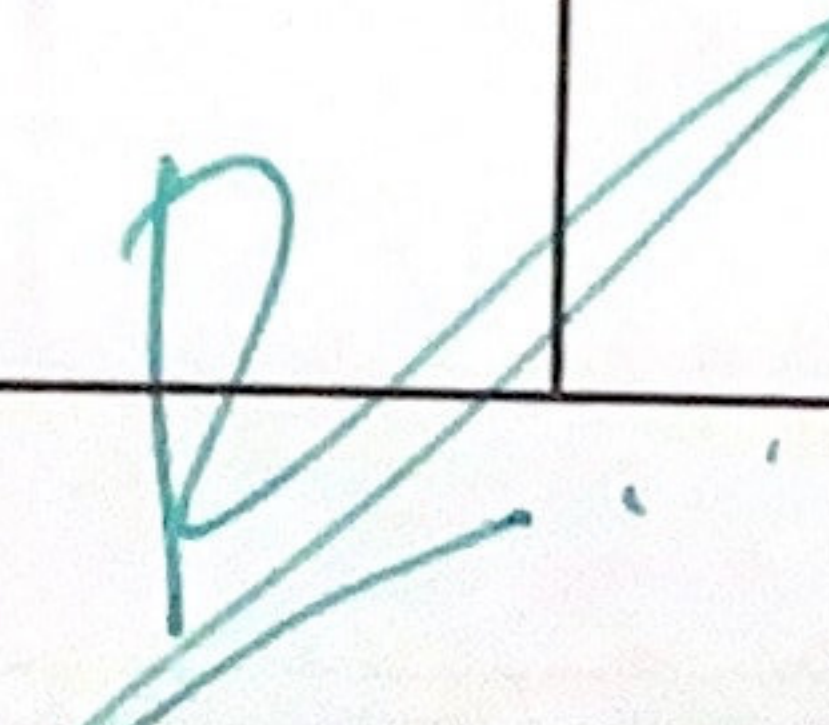
No:PHI/Water/BAC/ 634/2025-26

Office of the Joint Director
Public Health Institute
Bengaluru - 560 001

Dated: 24/06/2025

Report of Bacteriological analysis of Water/Effluent sample

	Opinion							
	Sample No.	Source & Particulars of Water Sample	M.P.N Count	Plate Count	D.C Test	S.P.P	N.S.P.P	N.S.P.P & FC.
Principal SFS School Nachohalli Kolar Road Malur Kolar - 563130	1396	RO outlet	Nil	—	—	SPP	—	—
Note: M.P.N Count: Most probable number of Bacteria per 100ml of Water D.C Test: Differential Coliform test Plate Count: Plate Count per ml of sample SPP: Water is satisfactory for Potable purpose NSPP: Water is not satisfactory for Drinking purpose NSPP & FC: Water is not satisfactory for Drinking purpose and E.Coli found								


 For Joint Director (Labs)
 PUBLIC HEALTH INSTITUTE
 Bengaluru

(PTO)